

# AOCs at Metersets

Presented at 2022 NGA Fall Operations Conference

Saratoga NY

Joe Morello

OQ Manager







This is our way of protecting our tracer wire...it could be a little neater...

Foreign wire clamped to our piping (NG)





Foreign wire connected to our meter casing (NG)






Foreign wire clamped to our drive bar (NG)







Foreign wire clamped to our piping (NG)

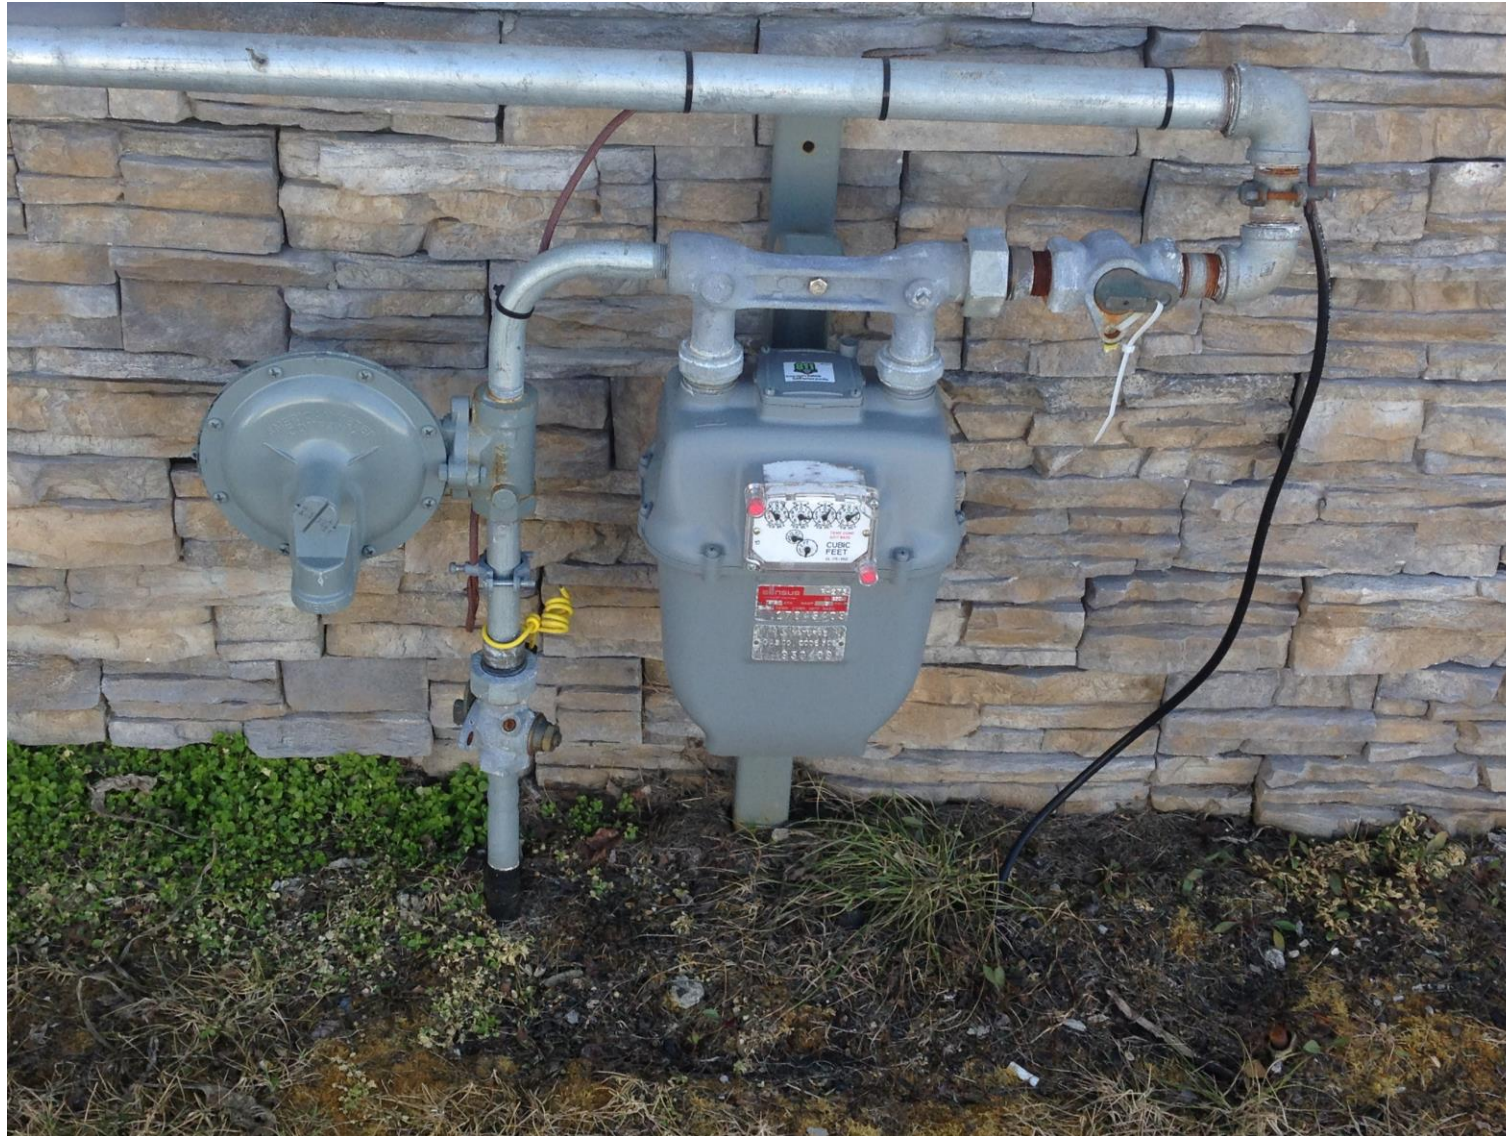






10/5/2022

NJNG Meterset AOCs

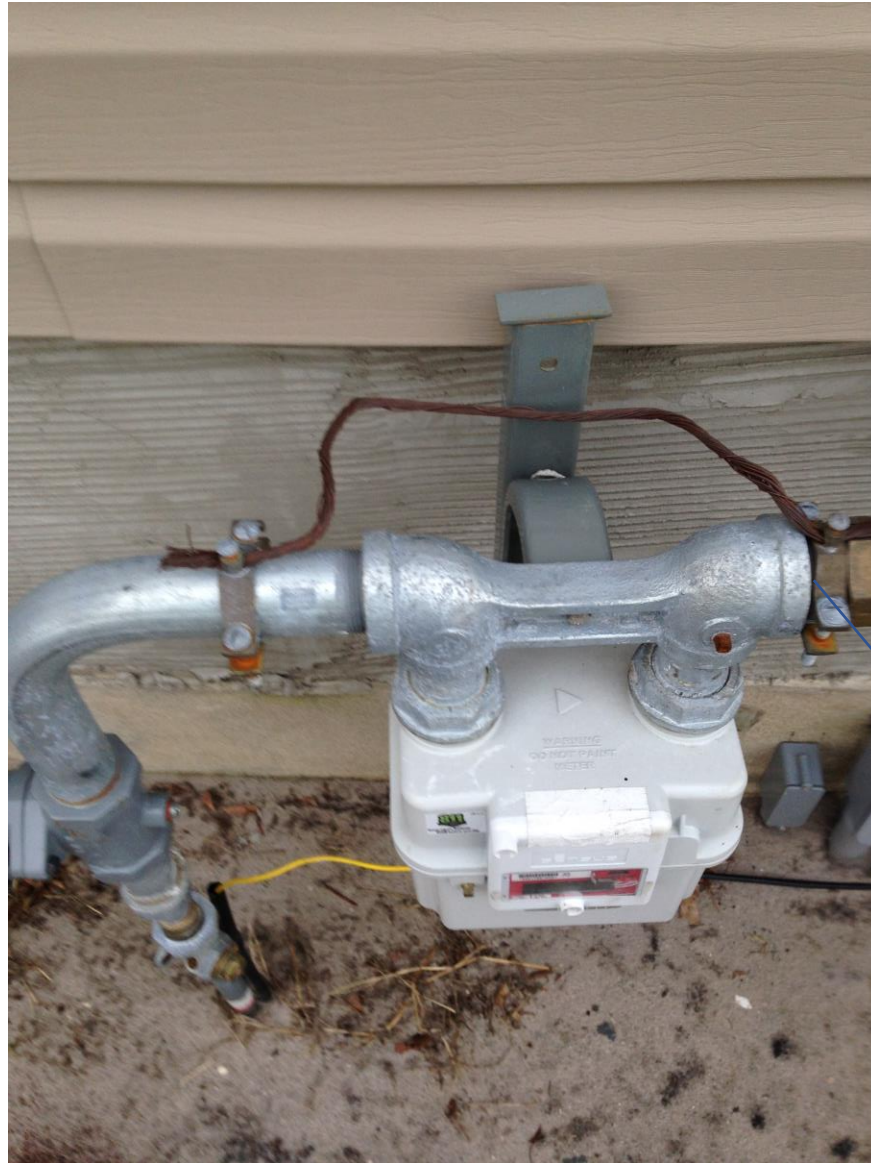

Foreign wire clamped to our piping (NG)



10/5/2022

NJNG Meterset AOCs







10/5/2022

NJNG Meterset AOCs






Foreign wire clamped to our piping (NG)



10/5/2022

NJNG Meterset AOCs



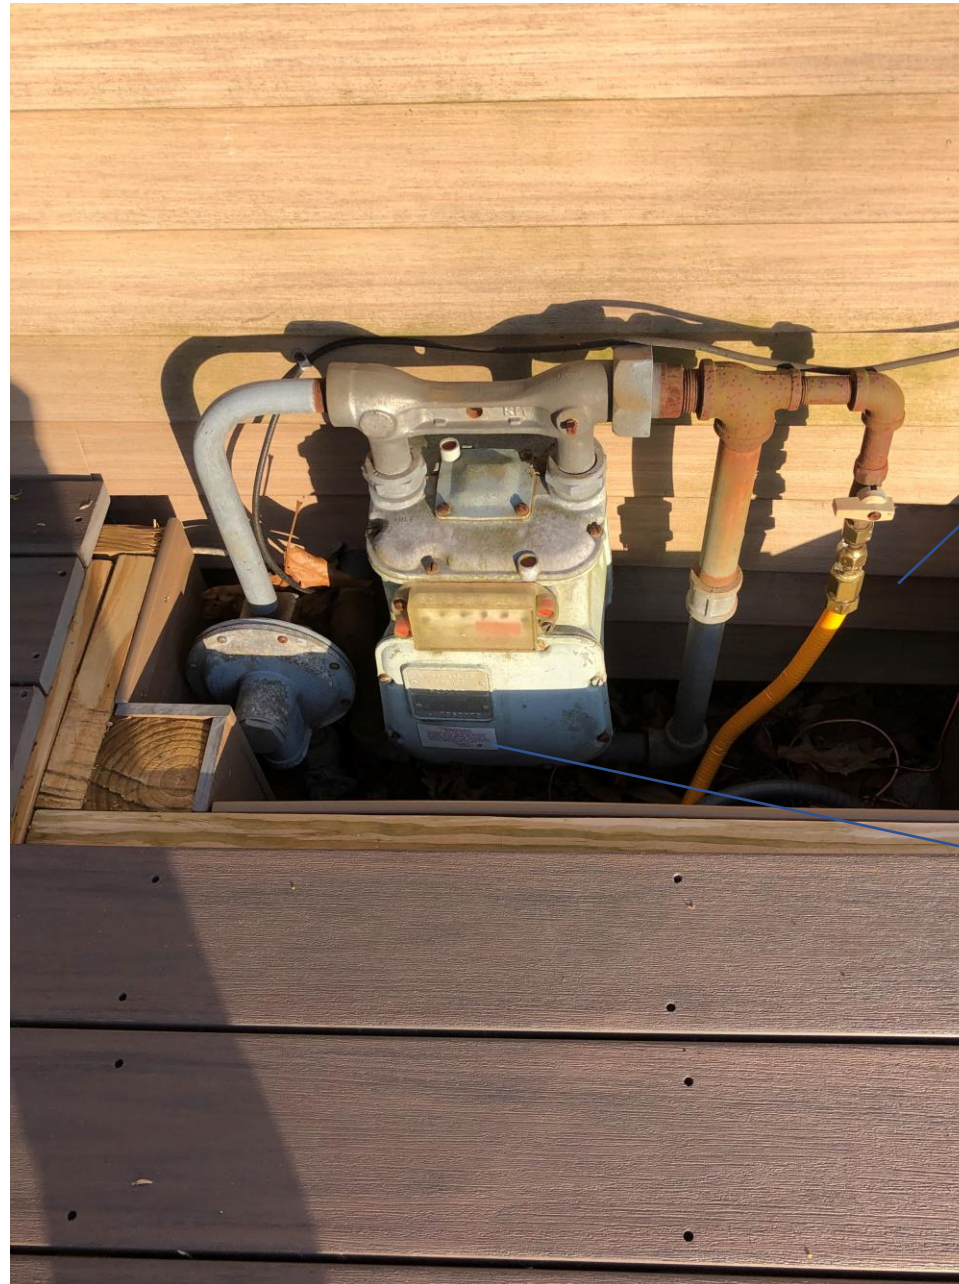

Improperly installed CSST

Inadequate access to our meterset



10/5/2022

NJNG Meterset AOCs






Meterset installed away from structure OR did the structure move?






Boiler drain valve on gas piping (NG)

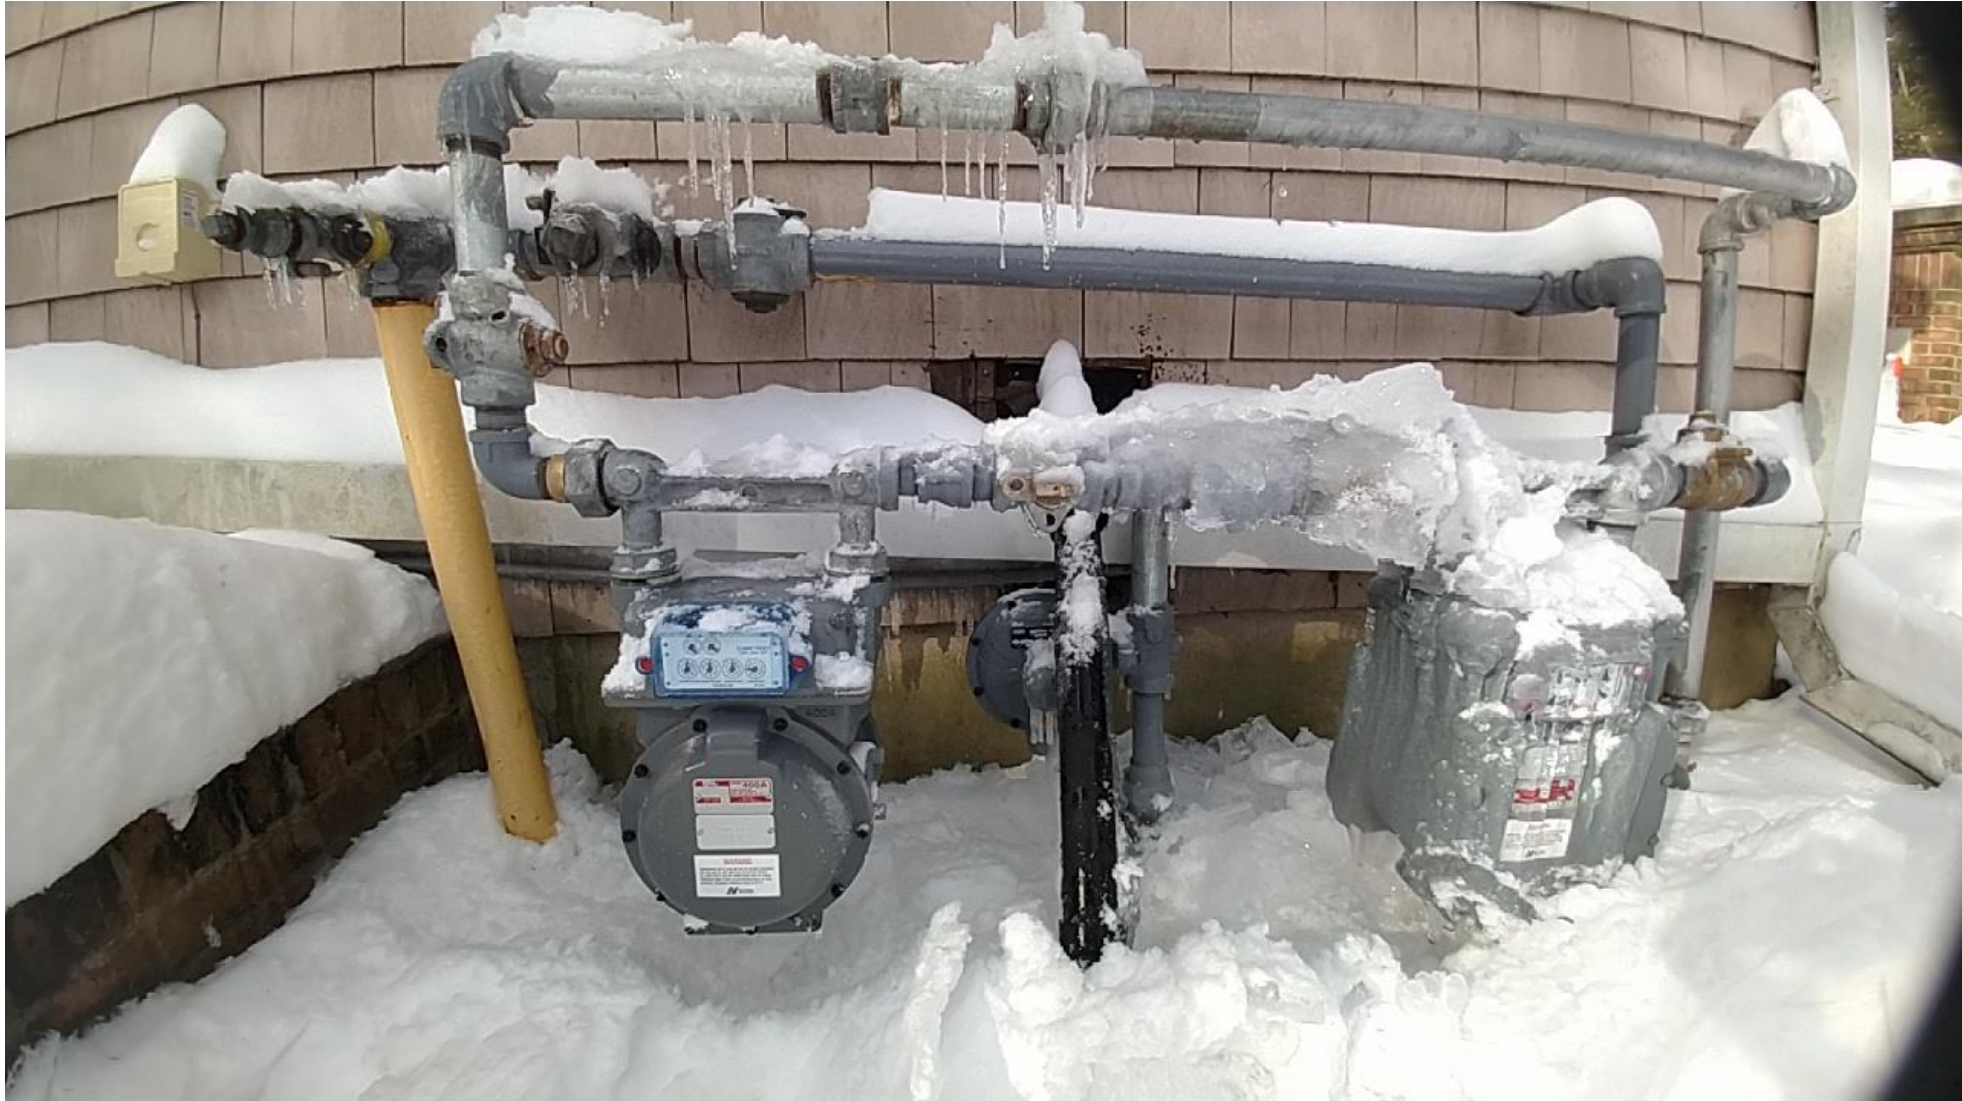



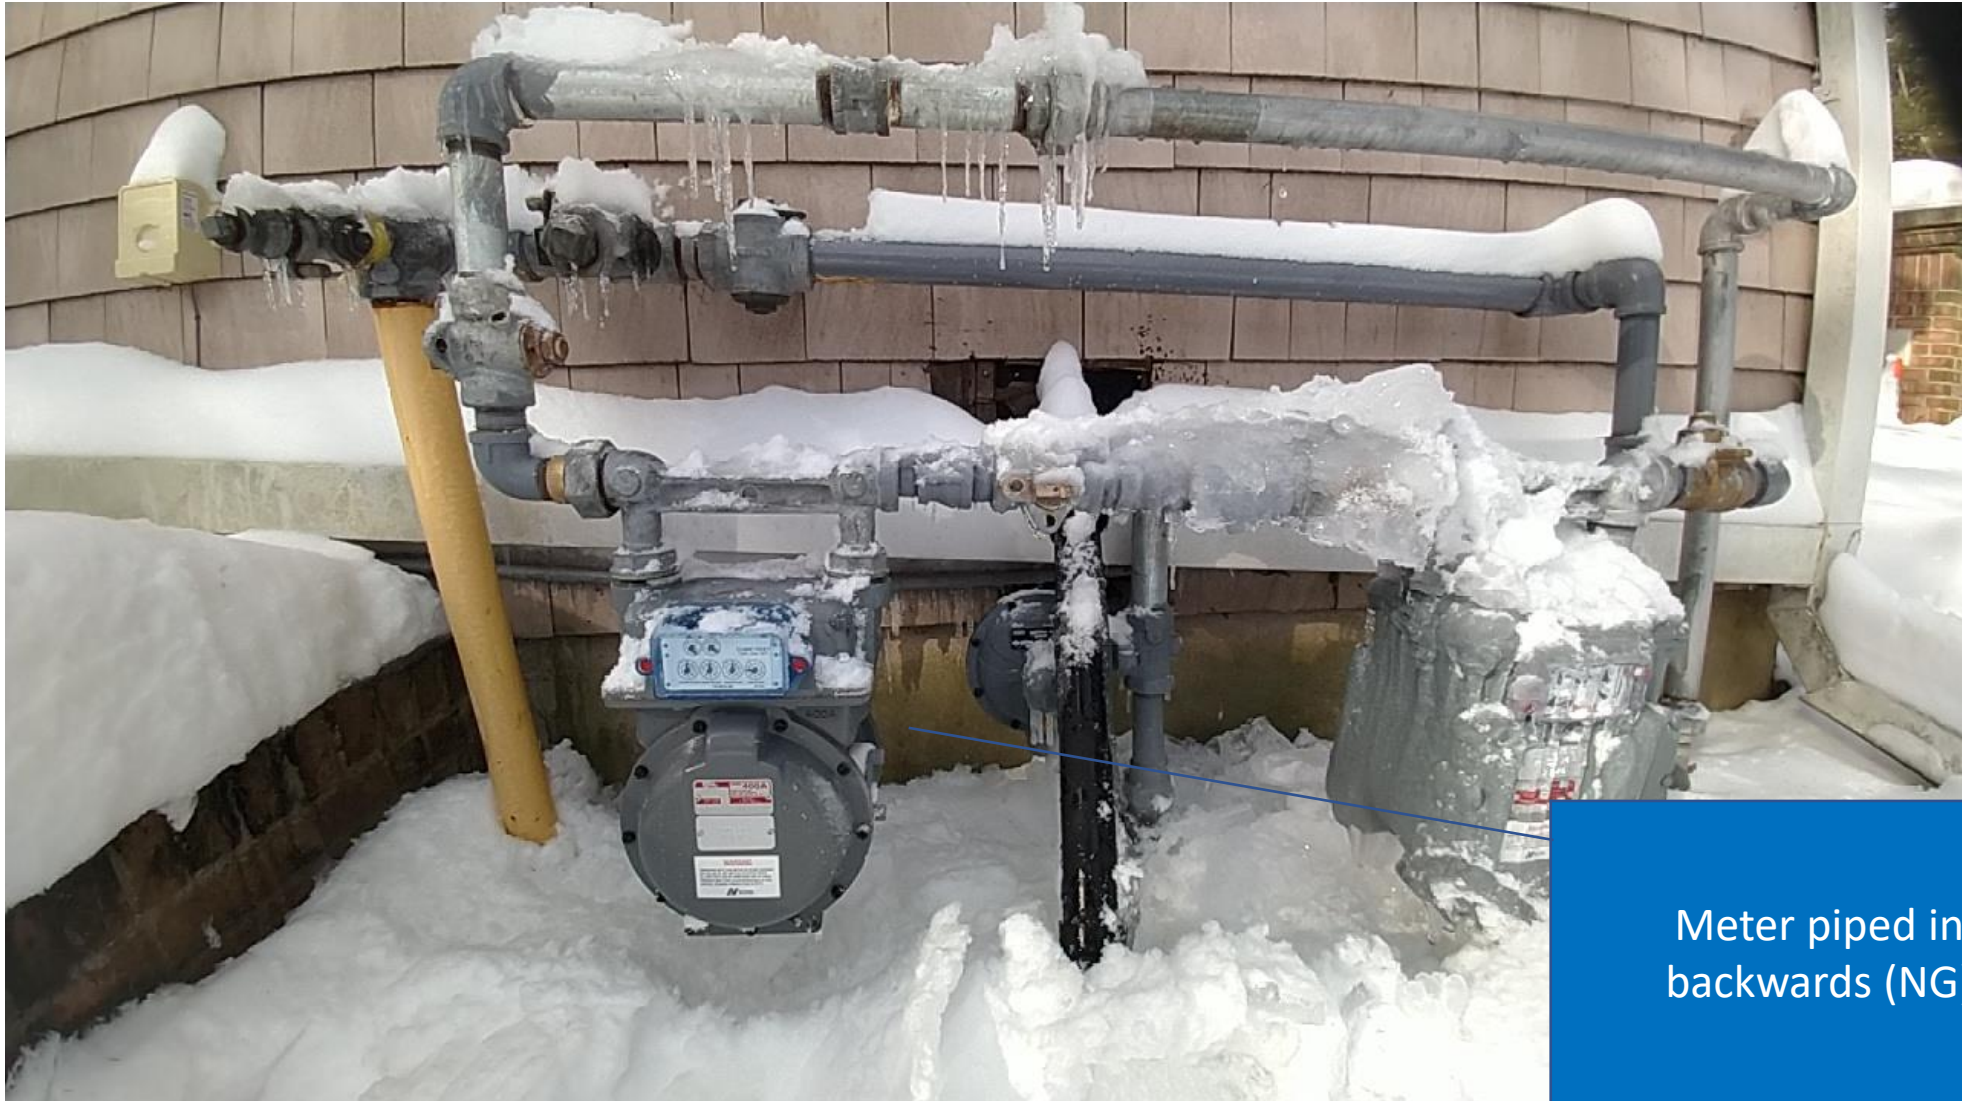

Meter piped in backwards (NG)





No inlet shut off valve for far left meter (NG)